

Appendix G: Updated Monitoring and Management Plans

APPENDIX G.9: WATER MANAGEMENT PLAN – DORIS-MADRID



AGNICO EAGLE

HOPE BAY PROJECT

Doris-Madrid Water Management Plan

JANUARY 2024

VERSION 18

Revisions

Revision #	Date	Section	Changes Summary	Author	Approver
0	October 2006	New Document	Initial version of the Water Management Plan submitted with the 2006 water licence application	MHBL	MHBL
1	April 2007	Throughout	Consolidation of information on water management facilities	MMC	MHBL
2	December 2010	Throughout	Updated in accordance with Type A Water Licence 2AM-DOH0713	SRK	HMBL
3	July 2011		Address monitoring of Doris Lake water levels, address party review comments, RO water treatment	SRK	HBML
4	December 2011		Include Table of Concordance, incorporate underflow sumps	SRK	HBML
5	February 2012		Approved Doris North Interim Water Management Plan under 2AM-DOH1323	SRK	HBML, NWB
6	December 2012		Update to address Part F Item 1.a.,b.,c. of Water Licence	SRK	HBML
7	June 2015	Throughout	Update to TMAC as current licensee for the Hope Bay region. Changes to document structure for operational suitability and efficiency	TMAC (SRK)	TMAC
		Sections <ul style="list-style-type: none"> • 1.3; • 2.2; • 2.5; • 2.7; • 2.8; • 4. 	Addition of: Doris North Infrastructure Monitoring Program Contact Water Pond 2 Talik water management Revised: Effluent discharge criteria TIA Decommissioning Water management contingencies		
		Module A	Underground talik water management, addition of proposed second Contact Water Pond, TIA discharge to Roberts Bay		
8	August 2016	Sections	Updated to focus on Operations once tailings deposition has started. Inclusion of changes arising from party comments through Amendment Application process: Consideration of freshet Consistency with other TMAC documents Inclusion of relevant Standard Operating Procedures	TMAC	TMAC

Revision #	Date	Section	Changes Summary	Author	Approver
			Addition of Interim Water Management Strategy Characterization of TIA inputs Management of TIA discharge during Care & Maintenance		
9	February 2016	Sections	Update to align with Amended Type A Water Licence 2AM-DOH1323	TMAC	TMAC
10	December 2017		Added Madrid North and South water mgmt. components	TMAC	TMAC
11	March 2019	3.2.4	Added Sump 3 and updated to align with Amended Type A Water Licence 2AM-DOH1335	TMAC	TMAC
12	March 2020	Sections	Updated to add details regarding RBDS. Clarified Madrid site to align with 2AM-DOH1335	TMAC	TMAC
13	March 2021	4.2.2	Updated to add Madrid WRP sumps	TMAC	TMAC
14	March 2022	Sections	Updated Madrid CWP Sump, section on erosion management and Discharge Criteria	AEM	AEM
15	April 2022	Sections	Added components for Care & Maintenance Plan submission	AEM	AEM
16	June 2022	Sections	Revised naming word choice from Pollution Control Pond to Contact Water Pond	AEM	AEM
17	March 2023	Sections	Updated as per comments from the 2021 NWB/NIRB Annual Reports and C&M Plan Comment Responses and addition of Doris CPRT and vent Raise diversion berm	AEM	AEM
18	March 2024	Sections: <ul style="list-style-type: none"> • Revisions Table • 3.2.1 • 3.2.2 • 3.2.3 • 3.2.5 • 3.2.10 Document Control	Updates to support 2022 NWB/NIRB Annual Report Comment Responses including: <ul style="list-style-type: none"> - Revisions to the Document Control table for increased specificity of changes made - Added reference to Section 5.5 of the plan, which contains additional details on frequency of inspections for water management infrastructures (e.g. sedimentation pond, contact water ponds 1 and 2, TIA and freshwater intake) - Revisions to clarify two TIA areas: Saline and contact water 	Agnico Eagle	Agnico Eagle

Revision #	Date	Section	Changes Summary	Author	Approver
			- Revisions to clarify management of saline and freshwater at site.		

Contents

1 Introduction	1
1.1 Relevant Legislation and Guidance	1
1.2 Related Agnico Documents and Programs	3
1.3 Plan Management and Execution	4
2 Water Management Strategy	5
2.1 Objectives	5
2.2 Water Classification	5
3 Doris Water Management	6
3.1 Management Approach	6
3.1.1 Non-Contact Water	6
3.1.2 Contact Water	6
3.1.3 Mine Water	7
3.1.4 Freshwater	7
3.1.5 Treated Sewage Water	7
3.2 Facilities	7
3.2.1 Sedimentation Pond	8
3.2.2 Contact Water Pond 1	9
3.2.3 Contact Water Pond 2 (not yet constructed)	10
3.2.4 Sumps	11
3.2.5 Tailings Impoundment Area	11
3.2.6 Mine Water	13
3.2.7 Water Treatment Plant	14
3.2.8 Quarry Water Management	15
3.2.9 Sewage Treatment	16
3.2.10 Freshwater Intake	16
3.2.11 Various Use Containment Sumps	17
4 Madrid Water Management	18
4.1 Management Approach	18
4.1.1 Non-Contact Water	18
4.1.2 Contact Water	18
4.1.3 Mine Water	19
4.1.4 Freshwater	19
4.1.5 Treated Sewage Water	19
4.2 Facilities	19
4.2.1 Madrid North Contact Water Pond	20
4.2.2 Sumps	21

4.2.3 Madrid South Primary Contact Water Pond..... 21

4.2.4 Madrid South Secondary Contact Water Pond 22

4.2.5 Quarry Water Management 23

4.2.6 Sewage Treatment..... 24

4.2.7 Freshwater Intake 24

4.2.8 Fuel Facility Water Management 25

5 Detailed Monitoring Plan..... 27

5.1 Monitoring Objectives..... 27

5.2 Erosion Management and Mitigation Measures..... 27

5.3 Monitoring Plan..... 27

5.4 Discharge Criteria 33

5.5 Inspections 34

5.6 Documentation and Reporting..... 34

5.6.1 Record Keeping 35

5.6.2 Monitoring 35

6 Closure and Care and Maintenance 36

6.1 Water Management at Closure and Post-Closure 36

6.2 Care and Maintenance Options..... 36

7 References..... 37

Tables

Table 1-1. List of federal and territorial regulations and guidelines governing the Hope Bay Project Doris and Madrid Water Management Plan	2
Table 1-2. List of documents related to the Hope Bay Project Doris and Madrid Water Management Plan	3
Table 1-3. Roles and responsibilities.....	4
Table 2-1: Water Classification	5
Table 3-1: Facilities within the Doris Mine Area and Associated Water Management Infrastructure.....	8
Table 4-1: Facilities within the Madrid Mining Area and Associated Water Management Infrastructure	19
Table 5-1 Water monitoring at Doris Site (Adapted from the Hope Bay Quality Assurance and Quality Control Management Plan).....	28
Table 5-2a: Water monitoring at Madrid sites based on Type A Water Licence No. 2AM-DOH1335 (Adapted from the Hope Bay Quality Assurance and Quality Control Management Plan)	30
Table 5-3b: Water monitoring at Madrid sites based on Type B Water License No. 2BB-MAE1727 (Adapted from the Hope Bay Quality Assurance and Quality Control Management Plan)	30
Table 5-4 Effluent limits during periods of discharge to Roberts Bay	33

Figures

- Figure 1: Doris Water Management Flow Diagram
- Figure 2: Madrid Water Management Flow Diagram
- Figure 3a and 3b: Doris Water Monitoring Locations
- Figure 4: Madrid Water Monitoring Locations

Glossary

Term	Definition
AEM	Agnico Eagle Mines
AEMP	Aquatic Effects Monitoring Program
CCME	Canadian Ministers of the Environment
CWP	Contact Water Pond
DOE	Department of Environment
ECCC	Environment and Climate Change Canada
GN	Government of Nunavut
CIRNAC	Crown Indigenous Relations and Northern Affairs Canada
KIA	Kitikmeot Inuit Association
MHBL	Miramar Hope Bay Ltd.
MMC	Miramar Mining Corporation
MDMER	Metal Mining Effluent Regulations
NIRB	Nunavut Impact Review Board
MMB	RBDS Pumphouse
NWB	Nunavut Water Board
RBDS	Roberts Bay Discharge System
TIA	Tailings Impoundment Area
The Plan	Water Management Plan
TMAC	TMAC Resources Inc.
WTP	Water Treatment Plant

1 Introduction

This *Hope Bay Doris and Madrid Water Management Plan* (the Plan) has been prepared by Agnico Eagle Mines Limited (Agnico) in accordance with various water licences held by Agnico associated with developments throughout the Hope Bay region.

The Plan is intended primarily for use by Agnico and its contractors to ensure that best practices are employed throughout all water management activities associated with the operation, closure and care and maintenance of the Doris and Madrid sites, thus ensuring water licence conditions are met and minimal potential downstream environmental impacts occur.

This document outlines Agnico’s approach to water management as it pertains to the Doris and Madrid sites.

1.1 Relevant Legislation and Guidance

Table 1-1 provides a summary of federal and territorial regulations governing the Hope Bay Water Management Plan and associated guidelines.

Table 1-1. List of federal and territorial regulations and guidelines governing the Hope Bay Project Doris and Madrid Water Management Plan

Regulation	Year	Governing Body	Relevance
Nunavut Waters Regulations	2013	Nunavut Water Board	Licence for mining and milling undertaking to use water and deposit of waste in relation to the construction, operation, closure and reclamation.
Environmental Protection Act	1988	Government of Nunavut (GN), Department of Environment (DOE), Environmental Protection division	Legislation to authorize discharge of water
Environmental Rights Act	1988	GN, DOE, Environmental Protection division	Grants all residents the ability to launch an investigation
Metal Mining Effluent Regulation (MDMER)	2002	Federal Department of Fisheries and Oceans & Environment Canada	Allows for the designation of a water body for the deposition of mine waste and outlines requirements for mine-related discharges.
Territorial Lands Act	1985	Indigenous and Northern Affairs Canada (INAC)	Crown lease and land use permit
Guideline	Year	Issued by	Relevance
Canadian Environmental Quality Guidelines	1999	Canadian Council of Ministers of the Environment (CCME)	Provides guidance on water quality for the protection of aquatic life; both freshwater and marine

1.2 Related Agnico Documents and Programs

Table 1-2 provides a summary of documents related to the Hope Bay Water Management Plan.

Table 1-2. List of documents related to the Hope Bay Project Doris and Madrid Water Management Plan

Document Title	Year	Relevance
Hope Bay Project Waste Rock,Ore and Mine Backfilling Management Plan	2022	Management of surface contact water
Hope Bay Project Domestic Wastewater Treatment Management Plan	2017	Management of treated effluent
Hope Bay Project Spill Contingency Plan	2023	Spill response procedures
Tailings Impoundment Area Operations, Maintenance and Surveillance Manual	2023	Management of excess water from the TIA
Quality Assurance and Quality Control Plan	2022	Sampling practices document that is reviewed and approved by the NWB
Hope Bay Project Groundwater Management Plan	2022	Management of groundwater
Doris Water and Load Balance Model	2017	Identification of source terms, modelling results
Doris North Infrastructure Monitoring Program	2017	Water Management facility inspections
Standard Operating Procedure: Compliance Sampling – Water Samples (REF # ENV-SOP-EM-002)	2021	Procedures to be followed for sampling water quality within containment berms and sumps, planning and execution of compliant water discharge

1.3 Plan Management and Execution

This Plan is reviewed annually and updated as needed.

Personnel responsible for implementing and updating the Plan are identified in Table 1-3.

Table 1-3. Roles and responsibilities

Role	Responsibility
Mine General Manager	<ul style="list-style-type: none"> Overall responsibility for and implementation of this management plan; Provide the on-site resources to operate, manage, and maintain water management infrastructure, such as pipelines, diversion berms, lined ponds and holding tanks; Provide input on modifications to design and operational procedures to improve operational performance.
Maintenance Manager (or designate)	<ul style="list-style-type: none"> Conduct regular inspections of the water management facilities and audits of the maintenance records; Responsible for tracking water movements between the various water management facilities, including from the contact water ponds and sumps to the tailings impoundment area (TIA); Maintain records of the source, disposition and volume of water transported/discharged; Report irregularities identified during visual inspections to the Mine General Manager.
Environmental Superintendent (or designate)	<ul style="list-style-type: none"> Review and update this management plan as required; Monitor water quality in the ponds, TIA and discharge points; Assess whether water quality samples have met applicable regulatory standards and guidelines; Coordinate with the surface manager responsible for water movements between the various water management facilities to ensure compliance with all licence requirements; Audit of water management tracking records and all associated required reporting.

2 Water Management Strategy

2.1 Objectives

The objectives of water management at Hope Bay Mining areas are as follows:

- Minimize total volume of water which comes into contact with mining infrastructure by diverting non-contact runoff away from mining works;
- Capture and contain water which is deemed unsuitable for immediate discharge;
- Treat and dispose of water which cannot be discharged to meet water license requirements.

2.2 Water Classification

Water encountered at the Doris and Madrid mines is classified into five categories based on the contact surface. Each type of water is managed separately to achieve the water management goals, outlined in Section 2.1. Table 2-1 presents the water classifications.

Table 2-1: Water Classification

Type	Contact Surface
Non-Contact Water	Undisturbed runoff, runoff from access roads, overburden piles, quarries, fuel facilities, and landfills
Mine Water	Water which enters the underground workings
Contact Water	Runoff in contact with waste rock, ore stockpiles, tailings and process water
Freshwater	Freshwater from lake
Treated Sewage water	Domestic sewage

3 Doris Water Management

3.1 Management Approach

Figure 1 presents a flow diagram of the water management approach for the Doris Mining area. The following sections outline management and discharge strategy for each water classification.

3.1.1 Non-Contact Water

Best Management Practices (BMPs) will be put in place during construction of access roads and pads to ensure that sediment loading after initial material placement is controlled. This may include silt fences or coco matting around construction activities during the initial rainfall and snowmelt periods.

To divert water upstream of the mine area and reduce the amount of contact water, the Doris North diversion berm was constructed in 2011 and diverts water from the south slope of Doris Mountain away from the site. Diversion structures will be constructed upstream of the Doris Crown Pillare and Vent Raise berm and intercept to minimize water from entering the underground workings and divert the non-contact water towards Doris Lake and Doris Creek

Pad U does not require any diversion as it is on the downstream side of the existing access road to Doris Lake and the TIA. The surface of Pad U will be graded to ensure runoff and seepage flow to Contact Water Pond 2.

Runoff accumulating in individual quarries will be collected at the natural low point in each quarry area. If required, a sump may be constructed to improve containment of runoff at the based of the quarry. Excess waters will be tested against the discharge limits and suitable water will be discharged to the tundra at an approved location.

A sump exists at the natural low point in the landfarm. Vacuum trucks will dewater the sump and either discharge to surface or truck the water to Contact Water Pond #2, pending water quality results.

3.1.2 Contact Water

Contact water consists of tailings water, process water, waste rock and ore stockpile runoff. Process water is internally recycled in the Doris process plant, and excess water is sent to the TIA.

The TIA discharges to the RBDS Pumphouse, which pumps water to Roberts Bay.

Waste rock and ore stockpile runoff will be collected in contact water ponds, which will be dewatered to the TIA.

Sumps capture shallow groundwater discharge from the active layer, downstream of the contact water ponds. An automated float operated pump moves water from the sump back to the sedimentation ponds.

3.1.3 Mine Water

The Doris Mine will intercept talik and will therefore have mine inflows, according to the hydrogeological model (SRK, 2017b). For a period of time early in the mine life, Agnico will encounter saline groundwater similar in concentration to seawater, after which the salinity concentration is expected to decline due to an increased fresh water component of the mine inflow originating from Doris Lake.

Mine water is either sent to the TIA area or treated and discharged directly to Roberts Bay. Management of underground water at the TIA may include segregation from reclaim within the footprint of the TIA either upstream of an internal dike or within a cell at the tailings beach.

The management of any groundwater interception is presented in the Hope Bay Groundwater Management Plan (Agnico, 2022).

3.1.4 Freshwater

Freshwater for potable and domestic use is sourced from either the North or South Windy Lake water intakes, and freshwater for fire protection, dust suppression and other industrial uses is sourced from Doris Lake.

Process freshwater is sourced from Doris Lake.

3.1.5 Treated Sewage Water

Domestic sewage will be treated on-site in the sewage treatment plant and discharged either to the TIA or the tundra at an approved location.

3.2 Facilities

Table 3-1 provides a summary of mine infrastructure relevant to the Doris Madrid Water Management Plan. Doris SNP stations that exist outside of the below mentioned water management facilities include ST-10, ST-12, TL-2, TL-3, TL-4, TL-8, TL-9 and TL-10. Please see Table 5-1 for information on these stations.

Table 3-1: Facilities within the Doris Mine Area and Associated Water Management Infrastructure

Facility	Reporting to
Pad X (Main Camp)	Sedimentation Pond
Pad B (Laydown Area)	Sedimentation Pond
Pad C (Administrative Buildings)	Sedimentation Pond
Pad R (Fuel Storage Area)	Sedimentation Pond
Pad Y (Warehouse/Laydown Area)	Sedimentation Pond
Pad E/P (Laydown Area)	Sedimentation Pond
Pad D (Mill Terrace)	Contact Water Pond 1
Pad T (Waste Rock Storage Area)	Contact Water Pond 1
Pad Q (Ore Storage Area)	Contact Water Pond 1
Pad H/J (Ore Storage Area)	Contact Water Pond 1
Pad I (Ore and Waste Rock Storage Area)	Contact Water Pond 1
Pad F (Laydown Area)	Contact Water Pond 1
Pad G (Laydown Area)	Contact Water Pond 1
Pad U (Ore Storage Area)	Contact Water Pond 2
Sumps	Contact water ponds
Doris North Diversion Berm	Non-contact area away from site
Water Treatment Plant (s)	Roberts Bay
Tailings Impoundment Area	Roberts Bay
Doris CPRT and Vent Raise Diversion Berms	Non-contact area away from site

3.2.1 Sedimentation Pond

Surface runoff from pads located on the west side of the mine area reports to the existing sedimentation/holding pond. This pond also serves as a lined temporary holding pond for water from Contact Water Pond 1, the sumps, and other site water which is to be pumped to the TIA.

Operation

Water from this pond is pumped directly to the TIA on an as-needed basis. The existing sedimentation pond has capacity of 3,325 m³.

Monitoring

Water level in the pond should be measured weekly during the open water season, and more frequently during intensive rainfall or snowmelt periods.

The pumps should have in-line flow meters to quantify total discharge.

A water quality sample should be collected at ST-1 annually during operations. Further details on monitoring are presented in Section 5. If water quality meets the designed criteria for discharge, excess water may be discharged to tundra at an approved location.

Wildlife monitoring at the pond is conducted in accordance with the Wildlife Monitoring and Mitigation Plan (WMMP). Wildlife is monitored to ensure they are not consuming water from collection ponds or are exposed to the potentially harmful water. Water quality monitoring frequency and further assessment of potential impacts will be completed in accordance with the WMMP.

Inspection

The containment berm should be inspected by the Site Services department on a regular basis to check for signs of seepage, erosion, slumping, or other signs of possible failure mechanisms.

Regular inspection along the dewatering pipeline will be performed by the Site Services department to check for signs of leaks.

An annual inspection of the containment berm will also be conducted as part of the Annual Geotechnical Inspection by the Engineer of Record (EOR). Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year. More details are provided in Section 5.5.

3.2.2 Contact Water Pond 1

Pads located on the east side of the mine area are graded to ensure all runoff and seepage will be diverted and collected in Contact Water Pond (CWP1). CWP 1 is designed to be a retention pond for the 24 hr 1 in 25 year storm, and is adequately sized to accommodate typical freshet flows. The total volume of runoff captured in this pond will be transferred to the TIA.

Operation

It is expected that the pond will always be operated in a manner allowing pumping and/or trucking to commence as soon as the containment volume is large enough for one continuous hour of pumping.

Monitoring

Water level in the pond should be measured weekly during the open water season, and more frequently during intensive rainfall or snowmelt periods.

The pumps should have in-line flow meters to quantify total discharge.

A water quality sample should be collected at ST-2 annually during operations. Further details on monitoring are presented in Section 5. If water quality meets the designed criteria for discharge, excess water may be discharged to tundra at an approved location.

Wildlife monitoring at the pond is conducted in accordance with the Wildlife Monitoring and Mitigation Plan (WMMP). Wildlife is monitored to ensure they are not consuming water from pollution ponds or are

exposed to the potentially harmful water. If wildlife is seen at the ponds, water quality monitoring frequency may increase as per the WMMP.

Inspection

The containment berm should be inspected by the Site Services department on a regular basis to check for signs of seepage, erosion, slumping, or other signs of possible failure mechanisms.

Regular inspection along the dewatering pipeline will be performed by the Site Services department to check for signs of leaks.

An annual inspection of the containment berm will also be conducted as part of the Annual Geotechnical Inspection by the EOR. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year. More details are provided in Section 5.5.

3.2.3 Contact Water Pond 2 (not yet constructed)

Pad U will be located on the east side of the access road leading towards Doris Lake. The primary intent of use for Pad U is general laydown and temporary ore storage, if needed. The pad will be graded in a manner to ensure runoff and seepage is collected by a downstream contact water pond. The contact water pond will be designed to manage water and contain flow from the overall drainage area for a 100-year, 24 hour storm event.

Operation

The CWP 2 will always be operated in a manner allowing pumping to commence as soon as the containment volume is large enough for one continuous hour of pumping. All water will be transferred to the TIA.

Monitoring

Water level in the pond should be measured weekly during the open water season, and more frequently during intensive rainfall or snowmelt periods.

The pumps should have in-line flow meters to quantify total discharge.

A water quality sample should be collected at ST-13 annually during operations. Further details on monitoring are presented in Section 5. If water quality meets the designed criteria for discharge, excess water may be discharged to tundra at an approved location.

Wildlife monitoring at the pond is conducted in accordance with the Wildlife Monitoring and Mitigation Plan (WMMP). Wildlife is monitored to ensure they are not consuming water from collection ponds or are exposed to the potentially harmful water. If wildlife is seen at the ponds, water quality monitoring frequency may increase as per the WMMP.

Inspection

The containment berm should be inspected by the Site Services department on a regular basis to check for signs of seepage, erosion, slumping, or other signs of possible failure mechanisms.

Regular inspection along the dewatering pipeline will be performed by the Site Services department to check for signs of leaks.

An annual inspection of the containment berm will also be conducted as part of the Annual Geotechnical Inspection by the EOR. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year. More details are provided in Section 5.5.

3.2.4 Sumps

Sump 1 is constructed downstream of the Sedimentation CWP 1, downstream of the south-east corner of the facility. Sump 2 is constructed downstream of Pad F/G along the east edge of the TIA Access Road. Sump 3 is constructed approximately 40 m south-west of Sump 1, within the tundra. The sumps ensure any seepage that may be bypassing the pond or emanating from Pad F/G is captured and returned to the water management system via an automated float operated pump.

Monitoring

Water quality monitoring is not expected in the sumps.

The pumps should have in-line flow meters to quantify total discharge.

Inspection

Monthly inspections of the sumps should be performed by the Environment Superintendent or designate to ensure they are functioning as intended during flow periods.

An annual inspection of the sumps will also be conducted as part of the Annual Geotechnical Inspection by the EOR. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year.

3.2.5 Tailings Impoundment Area

The TIA is an existing facility bounded by the North Dam, which is water retaining, and the South Dam, which is solids retaining. During operations, sub-aerial tailings deposition occurs at the southern end of the facility with reclaim water being pumped from the Reclaim Pond in the north end of the facility. In addition, an interim dike was constructed in 2023, allowing the segregation of saline and non saline water. Saline water (mine water) is stored between the interim dike and the South Dam of the TIA; non-saline (contact water) is stored between the interim dike and North Dam.

During the operations, closure and care and maintenance phases additional characterization of TIA inputs as summarized in Table 5-1 will occur.

Operation

The TIA is operated to maintain sufficient water to supply the mill, while not exceeding the full supply level of 33.5 m and allowing for contingency water holding capacity. The current water management strategy is to convey all mine surface contact water to the non-saline section (between dike and North Dam) of the TIA. Compliant TIA water, in excess of operational needs, is discharged to Roberts Bay, via the RBDS Pumphouse, and through the water treatment plant, as required, located at the TIA. Based on inflow volumes, the TIA effluent and mine water may be co-disposed in Roberts Bay in compliance with the effluent quality limits outlined in License 2AM-DOH1335, Part I, Item 14, and the MDMER limits.

In the event of effluent non-compliance, discharge pipeline malfunction or excessive mine water inflows, the TIA has the capacity to contain water without discharging.

Monitoring

The following water quality samples will be collected from the TIA:

- At the reclaim pipeline at TL-1 on a monthly basis;
- Quarterly samples at the process plant in the tailings slurry line, TL-5;
- Monthly samples from the solids component of mill effluent at TL-6;
- Tailings sent underground will be sampled at TL-7 on a monthly basis;
- The water level in the pond is monitored and measured daily year round. Visual inspections are conducted more frequently during intensive rainfall or snowmelt periods.

Wildlife monitoring at the pond is conducted in accordance with the Wildlife Monitoring and Mitigation Plan (WMMP). Wildlife is monitored to ensure they are not consuming water from collection ponds or are exposed to the potentially harmful water. If wildlife is seen at the ponds, water quality monitoring frequency may increase as per the WMMP.

Inspection

Regular inspections of the TIA should be performed by the Site Services department to ensure the TIA is functioning as intended. An annual inspection of the TIA will also be conducted as part of the Annual Geotechnical Inspection by the design engineer. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year. More details are provided in Section 5.5.

3.2.6 Mine Water

The Doris Mine will intercept talik which will result in groundwater inflows. The mine inflows will be made up of fresh water from lake infiltrations and hypersaline water from the surrounding rock, with a water quality dominated by high salinity, specifically chloride. Agnico will actively manage and mitigate inflows to protect workers, the environment, and ensure the mine can keep operating.

Operation

Groundwater will be collected in underground sumps and pumped to surface, from where it will be treated and discharged to Roberts Bay, either directly, or via the Tailings Impoundment Area (TIA).

The management of any groundwater interception is presented in the Hope Bay Groundwater Management Plan (Agnico, 2022).

Monitoring

During periods of mine water discharge, either directly to Roberts Bay, or to the TIA, mine water is sampled as follows:

- Weekly water quality samples will be collected at TL-12 at the mine discharge point; and
- Twice annually from backfilled stopes as TL-11.

The Environmental Superintendent or designate is responsible for conducting and documenting inflow water quality sampling. A record of this sampling and results of this analysis will be maintained on site.

Daily flow measurements will also be collected at the main portal flow metering point.

Additional monitoring details are presented in Section 5 and in the Hope Bay Groundwater Management Plan (Agnico, 2020).

Inspection

The underground operational crews are responsible for regular inspections of safely accessible non-working areas and providing daily reports of active work areas. Non-working areas are inspected on a monthly basis, or as necessary, if combined flows from those areas are observed to increase at main collection sumps.

Where new inflow or a change in inflow higher than 250 m³/day is encountered, a description of the feature and related inflow characteristics are documented as part of the shift boss's daily mining report. This report includes:

- Description of features encountered;
- Inflow rates; and
- Estimated pressures.

An annual inspection of the underground workings will also be conducted as part of the Annual Geotechnical Inspection by the EOR. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year.

3.2.7 Water Treatment Plant

Operation

Underground mine water is pumped from a settling sump system to a WTP on surface designed to provide Total Suspended Solids (TSS) removal from the effluent stream prior to final discharge to Roberts Bay. The multi-stage process consists of coarse suspended solids removal via a lamella clarifier and the addition of a polymer flocculent followed by fine suspended solids removal utilizing multimedia filters. This treatment process is capable of meeting the authorized limits for TSS outlined in Schedule 4 of the MDMER.

Agnico is constructing an additional water treatment plant to treat TSS, in the vicinity of the reclaim pond at the TIA, that utilizes the Veolia Actiflo® technology. The water treatment plant will have the capacity to treat both underground and reclaim water streams prior to discharge to Roberts Bay. The Veolia system consists of a flocculation and sedimentation process with patented micro sand. The water treatment plant will also have capability to be expanded to treat metals and ammonia when required.

Monitoring

During periods of water treatment and discharge, either directly to Roberts Bay, or to the TIA, untreated and treated effluent is sampled as follows:

- Weekly water quality samples will be collected at TL-12 at the mine discharge point.
- Weekly water samples will be collected at TL-1 at the reclaim water intake point
- Weekly water quality samples will also be collected after treatment to determine the performance for the WTP.

The Environmental Superintendent or designate is responsible for conducting and documenting effluent water quality sampling. A record of this sampling and results of this analysis will be maintained on site.

Daily flow measurements are also collected at the WTP flow metering point.

Inspection

The Site Services department is responsible for the operation, maintenance and most aspects of surveillance for the WTP. This includes daily inspections of the WTP and all ancillary equipment to ensure they are functioning as intended.

3.2.8 Quarry Water Management

The quarries will be developed such that runoff drains to the low point and is confined within the quarry boundaries. Sumps will be constructed on an as-needed basis, depending on the geometry of the quarry. For further detail, reference the Quarry Management and Monitoring Plan (Agnico Eagle, 2022).

Monitoring

After storm events or snowmelt, a sample of the ponded water will be collected. Care will be taken to ensure that discharged water does not enter fish bearing waters and that the pump discharge is positioned in a manner that minimizes erosion and siltation of the area downstream of the discharge.

In the event that the quarry water does not meet the discharge criteria, an inquiry of the cause of the noted exceedance will be conducted, and appropriate mitigation developed. Any non-compliant water that needs to be discharged would be transported to the TIA.

3.2.9 Sewage Treatment

Domestic sewage will be treated on-site. During construction and closure, the treated effluent will be discharged to the tundra. The discharge pipeline will consist of a series of diffusers, situated such that each stream will flow in a different direction at the top of the catchment. During operations, the treated effluent will be discharged to tundra and/or pumped to TIA.

Domestic sewage will be treated on-site. During construction and closure, the treated effluent will be discharged to the tundra. The discharge pipeline will consist of a series of diffusers, situated such that each stream will flow in a different direction at the top of the catchment. During operations, the treated effluent will be discharged to tundra and/or pumped to TIA.

Monitoring

Discharge quantity is measured daily during periods of discharge. A monthly water quality sample will be collected during periods of discharge to the tundra. If the discharge is directed to the TIA, an annual water quality sample will be taken. The sample will be collected at the effluent discharge tank at ST-8. While discharging to the tundra, a sample will be collected downstream of the discharge point, prior to entering Glen Lake, at ST-9.

During discharge to the tundra, additional monitoring will take place at the diffusers. Signs of erosion will be noted and mitigation measures will be implemented by realigning the diffuser pipeline or protecting erodible material.

3.2.10 Freshwater Intake

Domestic and potable water for the camp will be sourced from Windy Lake via the existing Windy Camp intake structure as well as the new Windy Lake North Freshwater intake (SRK, 2017c).

The new Windy Lake North intake pipeline will follow the access road and will transition from shoreline to lakebed beneath a protective rock berm. The insulated heat-traced pipeline will be anchored to the lakebed beneath the rock berm until the lake depth is a minimum of 3 m year-round. The pipeline will continue to a lake depth of 5 m year-round. The pipeline intake will be installed with a fish screen to protect fish in the lake, as per the requirements of Department of Fisheries and Oceans (Department of Fisheries and Oceans, 1995). Additional freshwater is pumped from Doris Lake to the process plant.

Monitoring

A water quality sample will be collected on a monthly basis during active pumping periods from ST-7 in Doris Lake and at ST-7a in Windy Lake. Further details on monitoring are presented in Section 5.

Total water volume extracted from both lakes will be recorded and reported in monthly and annual reports.

Inspection

Regular inspection along the intake pipeline will be performed by the Site Services department to check for signs of leakage. More details are provided in Section 5.5.

3.2.11 Various Use Containment Sumps

Various containment sumps will capture runoff from associated land uses. Monitoring is summarized as follows:

- Non-hazardous landfill sump, sampled at ST-3 prior to discharge;
- Landfarm sump, sampled at ST-4 prior to discharge;
- Doris Plant Site Fuel Storage and Containment Area Sump, sampled seasonally at ST-5
- Plant site fuel storage and containment area sump, sampled at ST-6-a and ST-6b prior to discharge;

At each facility, if water is deemed acceptable for discharge, it will be safely discharged at an approved location. If water does not meet the effluent quality limits outlined in License 2AM-DOH1335, Part F, and the MDMER, it will be pumped or trucked to TIA.

Details on water quality monitoring at the landfarm and fuel storage and containment area sumps are presented in the Hydrocarbon Contaminated Material Management Plan (TMAC, 2017h).

4 Madrid Water Management

4.1 Management Approach

Figure 2 presents a flow diagram of the water management approach for Madrid Mining area. The following sections outline management and discharge strategy for each water classification. The Madrid site is currently operating under the existing Water Licence No. 2AM-DOH1335 (referred to as “Type A”). The Madrid Advanced Exploration Program operates under Water Licence No. 2BB-MAE1727 (referred to as “Type B”).

4.1.1 Non-Contact Water

Best Management practices will be put in place during construction of access roads and pads to ensure that sediment loading after initial material placement is controlled. This may include silt fences and coco matting around construction activities and during the initial rainfall and snowmelt periods.

Runoff collected in individual quarries will be collected at the natural low point in each quarry area. If required, a sump may be constructed to improve containment of runoff at the base of the quarry. Excess waters will be pumped to surface and tested against the discharge limits. Suitable water will be discharged to the tundra at an approved location.

A sump will be constructed at the natural low point in the fuel facilities at Madrid North and South. Vacuum trucks will dewater the sump and either discharge to surface or truck the water to the Primary contact water pond at Madrid North, pending water quality results.

To divert water upstream and adjacent of the crown pillar area and reduce the amount of contact water, the Madrid East diversion berm is planned to be constructed to divert water away from the crown pillar site.

4.1.2 Contact Water

Contact water consists of tailings water, process water, waste rock, crown pillar and ore stockpile runoff.

A concentrator will be constructed at the Madrid North site to process a portion of the Madrid North ore through a flotation circuit. The resulting tailings will be pumped via pipeline and deposited in the TIA. The concentrate will be trucked to the Doris process plant for gold extraction. Process water and tailings water are internally recycled in the concentrator as much as practical. Excess water is pumped to the TIA in the tailings stream (i.e. tailings at a higher moisture content).

Waste rock and ore stockpile runoff will be collected in contact water ponds which will be dewatered to the TIA. Crown pillar runoff will be directed to the bottom of the pit which will be dewatered to the TIA either by truck or conveyed in a waterline.

4.1.3 Mine Water

The Madrid North mine will intercept talik below Patch, Windy and Imniagut Lakes, and mining at Madrid South mine is expected to intercept the talik below Wolverine and Patch Lakes (SRK, 2017b). This intercepted mine water is expected to be saline similar in concentration to seawater.

Mine water will be pumped or hauled to the Doris WTP and discharged to Roberts Bay, as described in the Groundwater Management Plan (AEM, 2022). Excess mine water may be directed to the TIA either by truck or conveyed in a waterline.

4.1.4 Freshwater

Freshwater including potable and raw water for industrial use (brine mixing, and dust suppressant), will be sourced from Windy Lake via the existing water intake near the old Windy Camp, or if required from the Windy Lake North Fresh Water Intake (SRK, 2017c). Make-up water for the concentrator at Madrid North will be pumped from Doris Lake, and freshwater may be pumped from Patch Lake or Wolverine Lake, as needed.

4.1.5 Treated Sewage Water

There will not be a camp at the Madrid North or South sites. Sewage water will be trucked to Doris Site sewage treatment facility.

4.2 Facilities

Table 4-1 provides a summary of mine infrastructure relevant to the Madrid Water Management Plan. Madrid SNP stations that exist outside of water management facilities include MMS-7, MMS-9, MMS-10, MAE-14, MAE-15, and MAE-16. Please see Table 5-2a and Table 5-3a for information on these stations. Water management facilities not currently planned and not included in the below list include the Brine Mixing Facility (MMS-6).

Table 4-1: Facilities within the Madrid Mining Area and Associated Water Management Infrastructure

Facility	Reporting to
Madrid North Waste Rock Pile	Madrid North Contact Water Pond
Madrid North Ore Stockpile	Madrid North Contact Water Pond
Madrid North Equipment Pad	Madrid North Contact Water Pond
Madrid North Process Plant	Madrid North Contact Water Pond
Portal Laydown Area	Madrid South Secondary Contact Water Pond
Madrid South Waste Rock Pile	Madrid South Primary Contact Water Pond
Madrid South Ore Stockpile	Madrid South Primary Contact Water Pond
Madrid South Fuel Storage Facility	Madrid South Primary Contact Water Pond
Quarries	Windy Lake, tundra, or Primary Contact Water Pond
Sumps	Madrid North Contact Water Pond

Madrid East Diversion Berm	Non-contact area away from site
Madrid East Equipment Pad	Directed to the bottom of the crown pillar

4.2.1 Madrid North Contact Water Pond

The Madrid North CWP will capture contact water from the Madrid North concentrator area, ore stockpile, and waste rock pile. The pond will be situated against the contact water berm and access road and is discussed in more detail in the Contact Water Pond Berm Thermal Modelling report (SRK, 2017d). At the maximum level, the freeboard against the contact water access road berm is 1.3 m.

Operation

The pond should be operated at a near-empty level such that capacity is always available for the design rainfall and snowmelt events. After an inflow event, resulting from snowmelt or a precipitation event, pumps should be activated to dewater the Madrid North CWP to one of the following locations:

- Concentrator for use as make-up water to reduce the freshwater draw from Windy Lake;
- Tailings discharge line from Madrid North Concentrator to TIA; or
- Mine water line to the Doris WTP.

The maximum dewatering period is 14 days, based on the design capacity of the pond and pump. Should the pond water level approach the freeboard limit, dewatering should be immediately initiated via the pump and pipeline or hauled by tank truck.

Monitoring

Water level in the pond should be measured weekly during the open water season, and more frequently during intensive rainfall or snowmelt periods.

The pumps or tank trucks should have in-line flow meters to quantify total discharge.

A water quality sample will be collected prior to discharge at MAE-04(Type B)/ MMS-1 (Type A). If water quality meets the designed criteria for discharge, excess water may be discharged to tundra at an approved location. Further details on monitoring are presented in Section 5.

Wildlife monitoring at the pond is conducted in accordance with the Wildlife Monitoring and Mitigation Plan (WMMP). Wildlife is monitored to ensure they are not consuming water from collection ponds or are exposed to the potentially harmful water. If wildlife is seen at the ponds, water quality monitoring frequency will follow the requirements outlined in the WMMP.

Inspection

- The contact water pond access road berm should be inspected by the Site Services department on a regular basis to check for signs of seepage, erosion, slumping, or other signs of possible failure mechanisms.
- Regular inspection along the dewatering pipeline will be performed by the Site Services department to check for signs of leaks.

An annual inspection of the containment berm will also be conducted as part of the Annual Geotechnical Inspection by the design engineer. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year.

4.2.2 Sumps

Water management at the Madrid North Waste Rock Pile includes four water collection sumps located on the northern, eastern and western extents of the waste rock pile. Water management at the Madrid East (Naartok) crown pillar will include a water collection sump located at the base of the pit.

Agnico has installed an underflow interception sump to enhance the existing water management at the Madrid North Contact Water Pond. The sump is located downstream of the contact water pond and any water captured in the sump is returned to the contact water pond via an automated float operated pump.

Monitoring

Water level in the sumps should be measured weekly during the open water season, and more frequently during intensive rainfall or snowmelt periods.

Water quality monitoring is not expected in the sumps.

The pumps should have in-line flow meters to quantify total discharge.

Inspection

Monthly inspection of the sumps should be performed by the Environment Superintendent or designate to ensure they are functioning as intended during periods of flow.

An annual inspection of the sumps will also be conducted as part of the Annual Geotechnical Inspection by the design engineer. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year.

4.2.3 Madrid South Primary Contact Water Pond

The Madrid South Primary CWP captures contact water within the Madrid South site. The Primary CWP is contained against the contact water berm access road (SRK, 2017d), and is located west of the waste rock pile. At the maximum level, the freeboard against the contact water access road berm is 1.3 m.

Operation

The pond should be operated at a near-empty level such that capacity is always available for the design rainfall and snowmelt events.

After an inflow event, resulting from snowmelt or a precipitation event, pumps should be activated to dewater the Madrid South Primary CWP to the Madrid North CWP.

The maximum dewatering period is 14 days, based on the design capacity of the pond and pump. Should the pond water level approach the freeboard limit, dewatering should be immediately initiated via the pump and pipeline.

Monitoring

Water level in the pond should be measured weekly during the open water season, and more frequently during intensive rainfall or snowmelt periods.

The pumps should have in-line flow meters to quantify total discharge.

A water quality sample will be collected prior to discharge at MAE-05 (Type B) / MMS-2 (Type A). If water quality meets the designed criteria for discharge, excess water may be discharged to tundra at an approved location. Further details on monitoring are presented in Section 5.

Wildlife monitoring at the pond is conducted in accordance with the Wildlife Monitoring and Mitigation Plan (WMMP).

Inspection

The contact water pond access road berm should be inspected by the Site Services department on a regular basis to check for signs of seepage, erosion, slumping, or other signs of possible failure mechanisms.

Regular inspection along the dewatering pipeline will be performed by the Site Services department to check for signs of leaks.

An annual inspection of the containment berm will also be conducted as part of the Annual Geotechnical Inspection by the EOR. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year.

4.2.4 Madrid South Secondary Contact Water Pond

The Secondary CWP at Madrid South captures runoff from the portal laydown area and is confined by berms to the north and east, including the Portal Haul road. At the maximum level, the freeboard against the contact water access road berm is 1.3 m.

Operation

The pond should be operated at a near-empty level such that capacity is always available for the design rainfall and snowmelt events.

After an inflow event, resulting from snowmelt or a precipitation event, pumps should be activated to dewater the Madrid South Secondary CWP to the Madrid South Primary CWP.

The maximum dewatering period is 14 days, based on the design capacity of the pond and pump. Should the pond water level approach the freeboard limit, dewatering should be immediately initiated via the pump and pipeline.

Monitoring

Water level in the pond should be measured weekly during the open water season, and more frequently during intensive rainfall or snowmelt periods.

The pumps should have in-line flow meters to quantify total discharge.

A water quality sample will be collected prior to discharge at MAE-06 (Type B) / MMS-3 (Type A). If water quality meets the designed criteria for discharge, excess water may be discharged to tundra at an approved location. Further details on monitoring are presented in Section 5.

Wildlife monitoring at the pond is conducted in accordance with the Wildlife Monitoring and Mitigation Plan (WMMP).

Inspection

The contact water pond access road berms should be inspected by the Maintenance Manager on a regular basis to check for signs of seepage, erosion, slumping, or other signs of possible failure mechanisms.

Regular inspection along the dewatering pipeline will be performed by the Site Services department to check for signs of leaks.

An annual inspection of the containment berm will also be conducted as part of the Annual Geotechnical Inspection by the EOR. Results of the inspection are submitted with the 2AM-DOH1335 License Annual Report by March 31 of each year.

4.2.5 Quarry Water Management

The quarries will be developed such that runoff drains to the low point and is confined within the quarry boundaries. Sumps will be constructed on an as-needed basis, depending on the geometry of the quarry. For further detail, reference the Quarry Management and Monitoring Plan (Agnico Eagle, 2022).

Monitoring

After storm events or snowmelt, a sample of the ponded water will be collected. Quarries G, H, and I will have samples collected at MAE-11, MAE-12 and MAE-13, respectively (as required, under Type B). If the

water quality is acceptable for discharge, care will be taken to ensure that discharged water does not enter fish bearing waters and that the pump discharge is positioned in a manner that minimizes erosion and siltation of the area downstream of the discharge.

In the event that the quarry water does not meet the discharge criteria, an inquiry of the cause of the noted exceedance will be conducted, and appropriate mitigation developed. Any non-compliant water that needs to be discharged would be transported to one of the CWP's.

4.2.6 Sewage Treatment

Madrid North and South will be equipped with a portable wash car containing toilets, washbasins and showers with heated black and grey water day tanks. These tanks will be emptied via a vacuum sewage truck and transported to a holding tank at the Doris Site for blending into the Doris Site sewage treatment facility.

Monitoring for Doris sewage treatment facility is described in Section 3.2.9.

4.2.7 Freshwater Intake

Domestic, potable and industrial water, including water for brine mixing and dust suppressant, will be sourced from Windy Lake via the existing Windy Camp intake structure as well as the new Windy Lake North Freshwater intake (SRK, 2017c).

The new Windy Lake North intake pipeline will follow the access road and will transition from shoreline to lakebed beneath a protective rock berm. The insulated heat-traced pipeline will be anchored to the lakebed beneath the rock berm until the lake depth is a minimum of 3 m year-round. The pipeline will continue to a lake depth of 5 m year-round. The pipeline intake will be installed with a fish screen to protect fish in the lake, as per the requirements of Department of Fisheries and Oceans (Department of Fisheries and Oceans, 1995).

Make-up water for the concentrator at Madrid North will be pumped from Doris Lake. Water may also be pumped from Patch Lake and Wolverine Lake, as needed.

Monitoring

A water quality sample will be collected on a monthly basis during active pumping periods from the freshwater intake in Windy Lake (MAE-01 (Type B) / MMS-4a (Type A)), and from Patch Lake (at MAE-02 (Type B)), and from Wolverine Lake (MAE-03 (Type B)), as needed. Further details on monitoring are presented in Section 5.

An in-line flow meter will measure total water volume extracted from Windy Lake.

Inspection

Regular inspection along the intake pipeline will be performed by the Site Services department to check for signs of leakage.

4.2.8 Fuel Facility Water Management

Fuel facilities at Madrid North and South will include self-contained sumps.

Monitoring

After a storm event or snowmelt and prior to discharge, water samples will be collected from the following locations:

Under Water Licence 2BB-MAE1727:

- MAE-07 at Madrid North fuel storage area sump;
- MAE-08 at Madrid North fuel transfer station sump;
- MAE-09 at Madrid South fuel storage area sump; and
- MAE-10 at Madrid South fuel transfer station sump.

Under Water Licence 2AM-DOH1335:

- MMS-5 at the Madrid South Fuel Storage facility
- MMS-8 at the Madrid North Fuel Storage facility

Samples will be sent for analysis to an accredited laboratory. If water quality is within the required limits for discharge, the water will be discharged to the tundra at a location approved by the inspector, or else water will be discharged into one of the contact water ponds.

5 Detailed Monitoring Plan

5.1 Monitoring Objectives

The objective of the monitoring undertaken under this Plan is to:

- Comply with monitoring requirements outlined in applicable water licences, project certificates, and the MDMER;
- Ensure water in the TIA, and that is directed to the TIA is characterized to provide information for appropriate operation of the TIA, and so that it is available in case of an unintentional release;
- Ensure water being discharged to the environment meets the appropriate discharge limits;
- Ensure points of discharge to tundra are not negatively affected by pooling water or erosion; and
- Ensure tracking of water movement and volumes.

Monitoring is carried out in accordance with the Standard Operating Procedures.

5.2 Erosion Management and Mitigation Measures

Effective erosion and sediment control measures will be installed prior to construction work commencing to minimize the potential for the introduction of sediment into watercourse or waterbodies. Slopes from containment berms that contain loose or erodible, will be fortified under the direction of a QEP. An adequate supply of erosion and sediment control contingency supplies will be maintained at the site. The speed of any flowing water on site, specifically during periods of tundra discharge, will be minimized since the erosive power of flowing water increases exponentially with velocity (speed). Supplies include: Silt fence Tarps Polly sheeting Sandbags Hand tools Geotextile Erosion control matting (with anchors) Trash pumps (with suitable lengths of hose).

5.3 Monitoring Plan

Monitoring locations, frequency, and parameters for the Doris site are summarized in Table 5-1 as per the existing Type A Water Licence 2AM-DOH1335. Monitoring locations, frequency, and parameter for the Madrid site are summarized in Table 5-2 as per the existing Type A Water Licence 2AM-DOH1335 or the Type B Water Licence 2BB-MAE1727. Monitoring locations are presented in Figure 3 for Doris and Figure 4 for Madrid.

Table 5-1 Water monitoring at Doris Site (Adapted from the Hope Bay Quality Assurance and Quality Control Management Plan)

SNP Station	Description	Phase	Monitoring Parameters	Frequency during Operations and Anytime after Initial Deposit of Tailings to the TIA
ST-1	Doris Sedimentation Pond	Construction, Operation, Care and Maintenance, Closure	G, N1, MT and Total Sulphate, Total CN, Total Oil and Grease, Alkalinity, Chloride, and Total Metals by ICP-MS	Annually
ST-2	Doris Contact Water Pond	Construction, Operation, Care and Maintenance, Closure	G, N1, MT and Total Sulphate, Total CN, Total Oil and Grease, Alkalinity, Chloride, and Total Metals by ICP-MS	Annually
ST-3	Discharge from Non-hazardous Landfill Contact Water control sump	Construction, Care and Maintenance, Operation, Closure	G, MT and Total Ammonia-N, Total Sulphate, Total and Free CN, Total Oil and Grease	Annually. Once prior to every discharge onto the tundra
			D	Daily during periods of discharge
ST-4	Discharge from Landfarm sump	Construction, Operation, Care and Maintenance, Closure	G, HC, total Ammonium, total Lead	Annually. Once prior to every discharge onto the tundra
			D	Daily during periods of discharge
ST-5	Discharge from Doris Plant Site Fuel Storage and Containment Area Sump	Construction, Operation, Care and Maintenance, Closure	G, HC, Total Pb	Annually. Once prior to every discharge onto the tundra
			D	Daily during periods of discharge
ST-6a and ST-6b	Discharge from the Roberts Bay Fuel Storage and Containment Area Sumps	Construction, Operation, Care and Maintenance, Closure	G, HC, Total Pb	Annually. Once prior to every discharge onto the tundra
			D	Daily during periods of discharge
ST-7	Freshwater pumped from Doris Lake	Construction, Operation, Care and Maintenance, and Closure	G, N1, N2, MT and Free CN, Total CN, T-Ag, T-Ca, T-Cd, T-Cr, T-Hg, T-Mo, T-Se, T-Tl, and Total Oil and Grease, Cl	Monthly during periods of pumping
			D	Monthly during periods of pumping
			Cl-a	Annually
ST-7a	Freshwater pumped from the Windy Lake freshwater intake	Construction, Operation, Care and Maintenance, Closure	G, N1, N2, MT, Cl and, T-Ag, T-Cd, T-Cr, T-Hg, T-Mo, T-Se, T-Tl, T-Ca, and Total Oil and Grease, Free CN, Total CN	Monthly during periods of pumping
			B	
			D	
ST-8	Discharge from Doris Sewage Treatment Plant bio-membrane	Construction, Operation, Care and Maintenance, Closure	G, B, and Total Oil and Grease	Monthly when discharge to the Tundra, Annually when discharge to the TIA
			Location of discharge	Monthly during periods of discharge
			D	Daily during periods of discharge
ST-9	Runoff from Doris Sewage Treatment Plant discharge - downstream of wastewater treatment plant discharge point and just prior to flow entering Doris Lake	Construction, Operation, Care and Maintenance, Closure	G, B, and Total Oil and Grease	Monthly when ST-8 is discharged to the tundra
ST-10	Doris Site Runoff from Sediment Controls	Construction, Operations, Closure	TSS or Turbidity (following development and approval of a site-specific TSS-Turbidity)	Daily during periods of discharge
ST-11	Reagent and Cyanide Doris Storage Facility Sumps	Construction, Operation, Care and Maintenance, Closure	G, HC, MT, T-Ag, T-Ca, T-Cd, T-Cr, T-Hg, T-Mo, T-Se, T-Tl Total Ammonia, Total and Free Cyanide, and D	Annually
ST-12	Doris Lake	Operation, Closure	Water Level	Monthly
			Ice Thickness	Annually in April
ST-13	Doris Contact Water Pond associated to Pad U	Construction, Operation, Care and Maintenance, Closure	G, N1, MT and Total Sulphate, Total CN, Total Oil and Grease, Alkalinity, Chloride, and Total Metals by ICP-MS	Annually
			D	Daily during periods of discharge
TL-1	TIA at the Reclaim Pipeline	Operation, Care and Maintenance, Closure, Post-Closure	G, N1, N2, MT and TDS, Cl, Free CN, Total CN, T-Ag, T-Ca, T-Cd, T-Cr, T-Hg, T-K, T-Mo, T-Mg, T-Na, T-Se, T-Tl, HC, Fecal Coliforms	Monthly during Operations, Closure and Post-Closure Annually during Care and Maintenance
			Dissolved Oxygen, Redox Potential, BOD	Annually
			Acute Lethality	Annually during Post-Closure
			D	Daily during periods of discharge
TL-2	Doris Outflow Creek - upstream (at the flow monitoring station adjacent to the bridge)	Closure, Post-Closure	G, N1, N2, MT and TDS, Cl, Free CN, Total CN, T-Ag, T-Ca, T-Cd, T-Cr, T-Hg, T-K, T-Mo, T-Mg, T-Na, T-Se, T-Tl, Oil and Grease	Annually during Care and Maintenance Annually for 2 years prior to Post-Closure, and during Post-Closure, Increase to three times per year (under ice, freshet, and pre-freeze up), two years prior to breach of the North Dam.
		Operation	D	Daily upon commencement of mining in or beneath the Doris Lake Talik.
TL-3	Doris Outflow Creek (~80m downstream of the base of the waterfall)	Care and Maintenance, prior to any deposit of tailings to the TIA	G, N1, N2, MT and TDS, Cl, Free CN, Total CN, T-Ag, T-Ca, T-Cd, T-Cr, T-Hg, T-K, T-Mo, T-Mg, T-Na, T-Se, T-Tl, Total Oil and Grease D	Inactive
TL-4	TIA Discharge End-of-Pipe	Care and Maintenance, prior to any deposit of tailings to the TIA	G, N1, N2, MT, and TDS, Cl, Free CN, Total CN, T-Ag, T-Ca, T-Cd, T-Cr, T-Hg, T-K, T-Mo, T-Mg, T-Na, T-Se, T-Tl, T-Radium 226 Acute Lethality B D	Inactive
TL-5	Effluent from Doris Process Plant (tailings slurry/water)	Operations	G, N1, MT, and Free CN, Total CN, WAD CN, Sulphate, T-Cd, T-Cr, T-Hg, T-Mo, T-Se, and Total Metals by ICP-MS	Inactive
			Cyanate and Thiocyanate	Inactive
TL-6	Tailings Discharged into TIA (Solid Component) taken from a valve in the mill at the discharge end of the mill tailings pumps	Operations	Tonnage of dry tailings solids	Inactive
			MT and T-Cd, T-Cr, T-Hg, T-Mo, T-Se, Total Inorganic Carbon and Total Metals by ICP-MS (must include Sulphur)	Inactive

TL-7a	Detoxified tailings solids sent underground as backfill	Operations	Dry tonnage of detoxified tailings sent underground; Moisture content of backfill trucked underground	Inactive
TL-7b	Filtrate from TL-7a (Detoxified tailings sent underground as backfill)	Operations	Cyanate and Thiocyanate, WAD CN, Total Inorganic Carbon, Total Metals by ICP-MS (including Sulphur)	Inactive
TL-8	Reclaim water pumped from TIA to Mill Process water tank taken from a valve at the discharge end of the reclaim water pump	Operations	G, N1, N2, MT and Free CN, Total CN, T-Ag, T-Cd, T-Cr, T-Hg, T-Mo, T-Se, T-Tl	Inactive
			D	Daily during periods of pumping
TL-9	Detox tailings reactor tank (650-TK-565)	Monitoring and reporting is captured within the Water Management Plan		Inactive
TL-10	Water Column in deepest portion of Tail Lake and at a location away from the TIA Reclaim water floating pump house, sampled at surface, mid- depth and near bottom	Inactive		Inactive
TL-11	Seepage from Doris underground backfilled stopes	Operations	Visual inspection for seepage. If seepage present parameters to be monitored include N1 and pH, EC, Trace metals by ICP-MS, Alkalinity, Acidity, Sulphate, Total, Free and WAD CN	Survey Twice annually
TL-12	Doris Mine Water Discharge Point	Operations during continuous pumping	Chloride, TDS and nitrate	Weekly
			Total Ammonia, Nitrate, Nitrite, pH, EC, Total Metals by ICPMS, alkalinity, bromide, fluoride, sulphate, TSS, and Total and WAD Cyanide	Monthly
			D	Daily during periods of discharge

Table 5-2a: Water monitoring at Madrid sites based on Type A Water Licence No. 2AM-DOH1335
(Adapted from the Hope Bay Quality Assurance and Quality Control Management Plan)

SNP Station	Description	Phase	Monitoring Parameters	Frequency during Operations and Anytime after Initial Deposit of Tailings to the TIA
MMS-1	Madrid North Contact Water Pond	Construction, Operations, Care and Maintenance	G, N1, MT and Total Sulphate, Total CN, Total Oil and Grease, Alkalinity, Chloride, and Total Metals by ICP-MS	Sampled twice annually, Weekly water levels
MMS-2	Madrid South Primary Contact Water Pond	Construction, Operations, Care and Maintenance, Closure	G, N1, MT and Total Sulphate, Total CN, Total Oil and Grease, Alkalinity, Chloride, and Total Metals by ICP-MS	Sampled twice annually, Weekly water levels
MMS-3	Madrid South Secondary Contact Water Pond	Construction, Operations, Care and Maintenance, Closure	G, N1, MT and Total Sulphate, Total CN, Total Oil and Grease, Alkalinity, Chloride, and Total Metals by ICP-MS	Sampled twice annually, Weekly water levels
MMS-4a	Freshwater Intake at Windy Lake North	Construction, Operations, Care and Maintenance, Closure	G, N1, N2, MT and Free CN, Total CN, T-Ag, T-Ca, T-Cd, T-Cr, T-Hg, T-Mo, T-Se, T-Tl, and Total Oil and Grease, Cl, D	Sampled monthly during active pumping periods
MMS-4b	Freshwater Intake at Windy Lake South (Windy Camp)	Construction, Operations, Care and Maintenance, Closure	G, N1, N2, MT and Free CN, Total CN, T-Ag, T-Ca, T-Cd, T-Cr, T-Hg, T-Mo, T-Se, T-Tl, and Total Oil and Grease, Cl, D	Sampled monthly during active pumping periods
MMS-5	Discharge from Madrid South Fuel Storage facility	Construction, Operations, Care and Maintenance, Closure	G, HC, Total Pb	Annually. Once prior to every discharge to tundra
MMS-6	Brine Mixing Facility	Operations during continuous pumping	G, N1, Chloride, Fluoride, Bromide, Sulphate, TDS, EC, Total Metals ICP-MS, alkalinity, Total and WAD Cyanide	Sampled monthly during active pumping periods
MMS-7	Effluent from Madrid North Concentrator to TIA	Operations	G, N1, MT, and Free CN, Total CN, WAD CN, Sulphate, T-Cd, T-Cr, T-Hg, T-Mo, T-Se, and Total Metals by ICP-MS	Sampled quarterly during active pumping periods
MMS-8	Discharge from Madrid North Fuel Storage Facility	Construction, Operations, Care and Maintenance, Closure	G, HC, Total Pb	Annually. Once prior to every discharge to tundra
MMS-9	Site runoff from sediment controls during construction	Construction	TSS or Turbidity	Sampled daily during periods of discharge
MMS-10	Mine Water Discharge Point	Operations during continuous pumping	Chloride, TDS and nitrate	Weekly
			Total Ammonia, Nitrate, Nitrite, pH, EC, Total Metals ICP-MS, alkalinity, Fluoride, Bromide, Sulphate, TSS, and Total and WAD Cyanide	Monthly

Table 5-3b: Water monitoring at Madrid sites based on Type B Water License No. 2BB-MAE1727
(Adapted from the Hope Bay Quality Assurance and Quality Control Management Plan)

SNP Station	Description	Monitoring Parameters	Frequency
MAE-01	Madrid North, Freshwater intake at Windy Lake	D	Daily during periods of pumping
MAE-02	Madrid South, Freshwater intake at Patch Lake	D	Daily during periods of pumping
MAE-03	Freshwater intake at other Lakes	D	Daily during periods of pumping
MAE-04	Madrid North Pollution Control Pond (PCP) Water at the point of discharge	pH, TSS, Electrical Conductivity, Oil and Grease, Total Ammonia, Nitrate-Nitrite, Total Phenols, Total Alkalinity, Total Hardness, Chloride, Sulphate, Magnesium, Sodium, Calcium, Potassium, Total As, Cd, Cu, Cr, Fe, Pb, Hg, and Ni	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-05	Madrid South Pollution Control Pond No.1 Water at the point of discharge	pH, TSS, Electrical Conductivity, Oil and Grease, Total Ammonia, Nitrate-Nitrite, Total Phenols, Total Alkalinity, Total Hardness, Chloride, Sulphate, Magnesium, Sodium, Calcium, Potassium, Total As, Cd, Cu, Cr, Fe, Pb, Hg, and Ni	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-06	Madrid South Pollution Control Pond No.2 Water at the point of discharge	pH, TSS, Electrical Conductivity, Oil and Grease, Total Ammonia, Nitrate-Nitrite, Total Phenols, Total Alkalinity, Total Hardness, Chloride, Sulphate, Magnesium, Sodium, Calcium, Potassium, Total As, Cd, Cu, Cr, Fe, Pb, Hg, and Ni	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-07	Madrid North Fuel Storage Area Water Sump	pH, TSS, Sulphate, Chloride, Electrical Conductivity, Oil and Grease, Total Ammonia, BTEX, Total Arsenic, Total Lead, Total Trace Metals for a minimum of the following elements: Al, Sb, Ba, Be, Cd, Cr, Co, Cu, Fe, Pb, Li, Mn, Mo Ni, Se, Sn, Sr, Ti, U, V, Zn	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-08	Madrid North Fuel Transfer Station Water Sump	pH, TSS, Sulphate, Chloride, Electrical Conductivity, Oil and Grease, Total Ammonia, BTEX, Total Arsenic, Total Lead, Total Trace Metals for a minimum of the following elements: Al, Sb, Ba, Be, Cd, Cr, Co, Cu, Fe, Pb, Li, Mn, Mo Ni, Se, Sn, Sr, Ti, U, V, Zn	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-09	Madrid South Fuel Storage Area Water Sump	pH, TSS, Sulphate, Chloride, Electrical Conductivity, Oil and Grease, Total Ammonia, BTEX, Total Arsenic, Total Lead, Total Trace Metals for a minimum of the following elements: Al, Sb, Ba, Be, Cd, Cr, Co, Cu, Fe, Pb, Li, Mn, Mo Ni, Se, Sn, Sr, Ti, U, V, Zn	Once, prior to every discharge onto the tundra

		D	Daily during periods of discharge
MAE-10	Madrid South Fuel Transfer Station Water Sump	pH, TSS, Sulphate, Chloride, Electrical Conductivity, Oil and Grease, Total Ammonia, BTEX, Total Arsenic, Total Lead, Total Trace Metals for a minimum of the following elements: Al, Sb, Ba, Be, Cd, Cr, Co, Cu, Fe, Pb, Li, Mn, Mo Ni, Se, Sn, Sr, Ti, U, V, Zn	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-11	Quarry G Contact Water Sump	pH, TSS, Sulphate, Chloride, Electrical Conductivity, Total Ammonia, Total Arsenic, Total Nickel, Total Trace Metals for a minimum of the following elements: Al, Sb, Ba, Be, Cd, Cr, Co, Cu, Fe, Pb, Li, Mn, Mo Ni, Se, Sn, Sr, Ti, U, V, Zn	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-12	Quarry H Contact Water Sump	pH, TSS, Sulphate, Chloride, Electrical Conductivity, Total Ammonia, Total Arsenic, Total Nickel, Total Trace Metals for a minimum of the following elements: Al, Sb, Ba, Be, Cd, Cr, Co, Cu, Fe, Pb, Li, Mn, Mo Ni, Se, Sn, Sr, Ti, U, V, Zn	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-13	Quarry I Contact Water Sump	pH, TSS, Sulphate, Chloride, Electrical Conductivity, Total Ammonia, Total Arsenic, Total Nickel, Total Trace Metals for a minimum of the following elements: Al, Sb, Ba, Be, Cd, Cr, Co, Cu, Fe, Pb, Li, Mn, Mo Ni, Se, Sn, Sr, Ti, U, V, Zn	Once, prior to every discharge onto the tundra
		D	Daily during periods of discharge
MAE-14	Windy Lake immediately downgradient of the Pollution Control Pond Discharge	Chloride, Electrical Conductivity, Total Dissolved Solids (TDS)	Once prior to each discharge; and a maximum of two weeks post discharge
MAE-15	Patch Lake immediately downgradient of the Pollution Control Pond Discharge	Chloride, Electrical Conductivity, Total Dissolved Solids (TDS)	Once prior to each discharge; and a maximum of two weeks post discharge
MAE-16	Wolverine Lake immediately downgradient of the Pollution Control Pond Discharge	Chloride, Electrical Conductivity, Total Dissolved Solids (TDS)	Once prior to each discharge; and a maximum of two weeks post discharge

5.4 Discharge Criteria

Effluent discharged will be monitored as applicable and required under the MDMER. MDMER effluent discharge limits are presented Table 5-4. To discharge to Roberts Bay, the MDMER requires that effluent be non-acutely lethal when tested in accordance with the applicable Reference Method. The appropriate test is based on the salinity of the effluent and is presented in Table 5-5.

Table 5-4 Effluent limits during periods of discharge to Roberts Bay

Parameter	Units	Maximum Authorized Monthly Mean Concentration	Maximum Authorized Concentration in a Grab Sample
pH		6 to 9.5	6 to 9.5
Total Arsenic	mg/L	0.30	0.60
Total Copper	mg/L	0.30	0.60
Total Cyanide	mg/L	0.50	1.00
Total Lead	mg/L	0.10	0.20
Total Nickel	mg/L	0.50	1.00
Total Zinc	mg/L	0.50	1.00
Total Suspended Solids	mg/L	15.00	30.00
Total Radium 226	Bq/L	0.37	1.11
Unionized Ammonia	mg of N /L	0.50	1.00

Table 5-5 Acute Lethality Testing

	Salinity Level of Effluent			
	Salinity > 10 ppt	Salinity < or = 10 ppt	Salinity > 4 ppt	Salinity < or = 4 ppt
Marine Environment	Threespine stickleback	Rainbow trout	<i>Acartia tonsa</i>	<i>Daphnia magna</i>

Quarry water samples will be compared against quarry effluent quality limits as stated in Part D Item 18 Water License 2BE-HOP122 and presented in the Quarry Management Plan (Agnico, 2022).

5.5 Inspections

Routine visual inspections of all water management structures will be completed by site staff to determine whether the facilities are operating as designed and to assess maintenance requirements. Facility inspections are carried out following significant rain events and throughout the annual snowmelt period. Annual geotechnical inspections of all engineered facilities are carried out by the engineer of record. During construction activities, freshet and significant rainfall events, daily visual are completed to:

- Monitor for signs of erosion and implement mitigation measures to prevent entry of sediment to any water body;
- Integrity of all piping and other water conveyance structures;
- Signs of erosion or water pooling occurring during high flow periods;
- Volumes of water in the contact water ponds;
- Geotechnical integrity of contact water berms; and
- Integrity of erosion protection at point of discharge to the tundra.

Any irregularities identified during the visual inspection will be recorded and relayed to the Mine General Manager and/or the Engineer of Record for the facility in order to ensure corrective action can be implemented.

5.6 Documentation and Reporting

All monitoring data compiled will be documented and reported as prescribed under the water licence, MDMER, or otherwise. Any data not explicitly requiring monthly reporting under the Water Licence will be reported in the existing Annual Reports to the NWB. These reports will include but are not limited to:

- An assessment of data to identify areas of non-compliance with regulated discharge parameters;
- A summary of all water inputs to the water treatment plant, water treatment plant discharges and discharges to tundra; and
- Annual review of the water balance and water quality prediction model.
- Water management facility inspection and operations records will be retained on site and available for review upon request.
- An Annual Geotechnical Inspection Report will be submitted to the NWB annually.
- A Construction Monitoring Report will be prepared in applicable years and submitted to regulators where required. The report will include but is not limited to the following:
 - A summary of all inspections conducted during construction; and
 - Updated “As-built” drawings of the constructed infrastructure.

5.6.1 Record Keeping

Records of operation and maintenance are required to evaluate the effectiveness of the operation of all water management structures. Daily records include the following information:

- Volume, quality and discharge location of any effluent moved between facilities or discharged to environment; and
- Details of any construction or maintenance undertaken at site.

Record sheets and daily operations or inspection logs are maintained with the Site Services and Environmental Departments.

Results of sampling as presented in Table 5-1 and Table 5-2 are reported to the NWB in conjunction with Annual Reporting.

5.6.2 Monitoring

Monitoring of Doris Lake and Windy Lake water levels will occur under the Aquatic Effects Monitoring Program (AEMP). TIA water levels are monitored and reported in the Annual Geotechnical Inspection Report.

Sediment, Contact Water ponds, and contact water ponds will have permanent staff gauges to allow for visual monitoring of water accumulations in each pond. Weekly staff gauge readings converted to volumes will be recorded in for each pond.

All volumes of water movements will be monitored with flow meters, tracked by truck load, or otherwise quantified as appropriate during the transfers. These include, but are not limited to, movements from:

- Discharges to tundra;
- Transfers between sedimentation ponds, or contact water ponds;
- Transfers to the TIA;
- Groundwater to the RBDS Pumphouse;
- TIA excess water to RBDS Pumphouse, and
- MMB to Roberts Bay.

Water quality in the ponds, TIA and discharge points will be monitored in accordance the Water Licence and MDMER where applicable. Confirmation of compliance will be required prior to discharging any water from facilities, as applicable. The Environmental Department is responsible for water quality monitoring and compliance reporting.

6 Closure and Care and Maintenance

6.1 Water Management at Closure and Post-Closure

At closure, the remaining inventory of TIA water will be discharged to Roberts Bay. This can be done in one open water season. The small pond behind the North Dam will be filled in and the tailings surface covered, after which it is expected that surface water runoff from the TIA will be suitable to discharge to the Doris system. Water quality criteria in the TIA for discharge to the Doris System will be determined in advance of final closure and in consultation with interested parties. Once the discharge criteria is met, the North Dam can be breached and flow restored to the Tail Lake Outflow. Sampling of the TIA water would be conducted prior to Post-Closure to ensure the North Dam can be breached. This sampling will be outlined in the Final Closure Plan, and would be discussed with relevant parties prior to dam breaching. Following breaching of the dam, water quality will be monitored in accordance with the provisions of the water licence. Post-Closure sampling will be described in the Final Closure Plan and at the time of water licence renewal.

6.2 Care and Maintenance Options

Should the project be placed into Care and Maintenance following tailings deposition in the TIA, compliant water will continue to be discharged to Roberts Bay seasonally to maintain water levels at or below the full supply level. Monitoring will continue as described above and as required under the MDMER.

7 References

- Canadian Council of Ministers of the Environment (CCME). 1999. Canadian Environmental Quality Guidelines Summary Table. <http://st-ts.ccme.ca/>. Accessed April 2015.
- Department of Fisheries and Oceans. (1995). Freshwater Intake End-of-Pipe Fish Screen Guideline.
- Environmental Protection Act, RSNWT (Nu) 1988, c E-7
- Environmental Rights Act, R.S.N.W.T. 1988,c.83
- SRK Consulting Canada) Inc, 2017 a. Madrid-Boston Project Water and Load Balance, Hope Bay Project. December 2017.
- SRK Consulting (Canada) Inc., 2017b. Hydrogeological Characterization and Modeling of the Proposed Boston, Madrid South and Madrid North Mines, Hope Bay Project. Prepared for TMAC Resources Inc. Project No. 1CT022.013.
- SRK Consulting (Canada) Inc., 2017c. Windy Lake North Freshwater Intake Design. Prepared for TMAC Resources Inc. Project No. 1CT022.013.
- SRK Consulting (Canada) Inc., 2017d. Hope Bay Project: Contact Water Pond Berms Thermal Modelling. Memo prepared for TMAC Resources Inc. Project No.: 1CT022.013.
- Agnico Eagle Mines Limited., 2023. Hope Bay Project Waste Rock, Ore, and Mine Backfill Management Plan. March 2023.
- TMAC Resources Inc, 2017b. Hope Bay Project Domestic Wastewater Treatment Management Plan. December 2017.
- Agnico Eagle Mines Limited., 2023. Hope Bay Project Spill Contingency Plan. March 2023.
- TMAC Resources Inc., .2017d.Hope Bay Project, Phase 2, Doris Tailings Impoundment Area – Operations, Maintenance, and Surveillance Manual . December 2017.
- Agnico Eagle Mines Limited., .2023. Quality Assurance and Quality Control Plan. March 2023
- Agnico Eagle Mines Limited., 2022. Hope Bay Project Groundwater Management and Monitoring Plan. March 2020.
- Agnico Eagle Mines Limited, 2022. Hope Bay Project Quarry Management Plan.
- TMAC Resources Inc., .2017h. Hope Bay Project, Hydrocarbon Contaminated Material Management Plan. December 2017.

FIGURES

Figure 1 Water Management Schematic-Doris

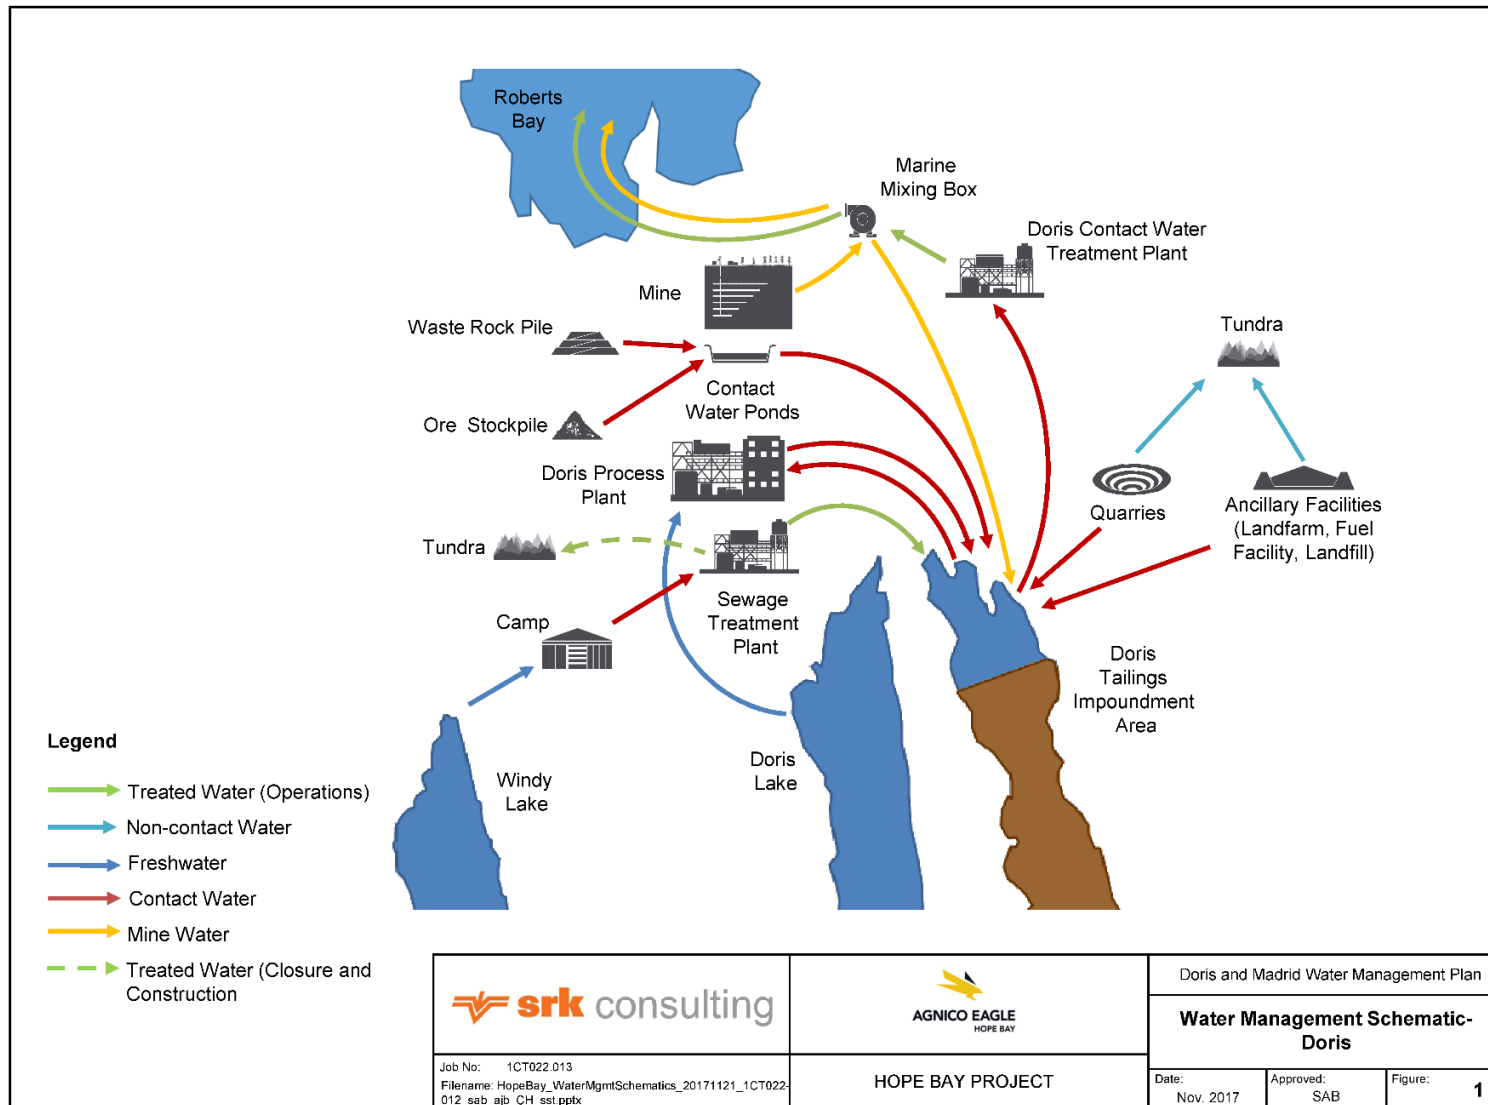


Figure 2 Water Management Schematic- Madrid


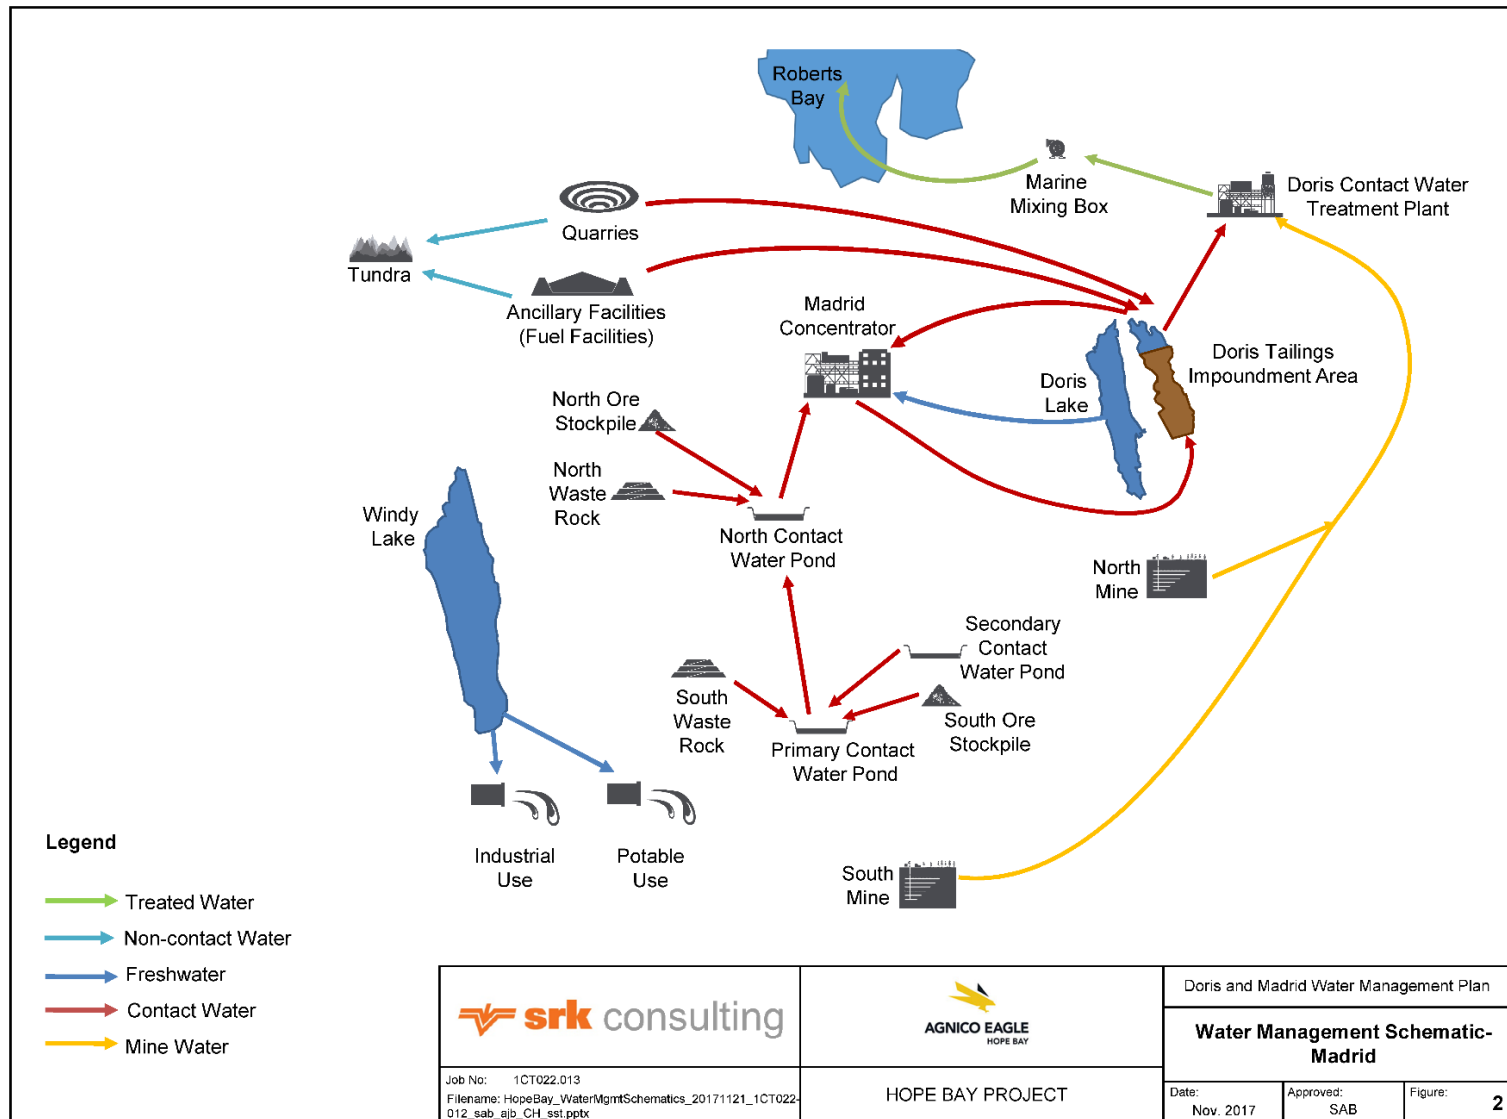


Figure 3a Doris SNP Sample Stations

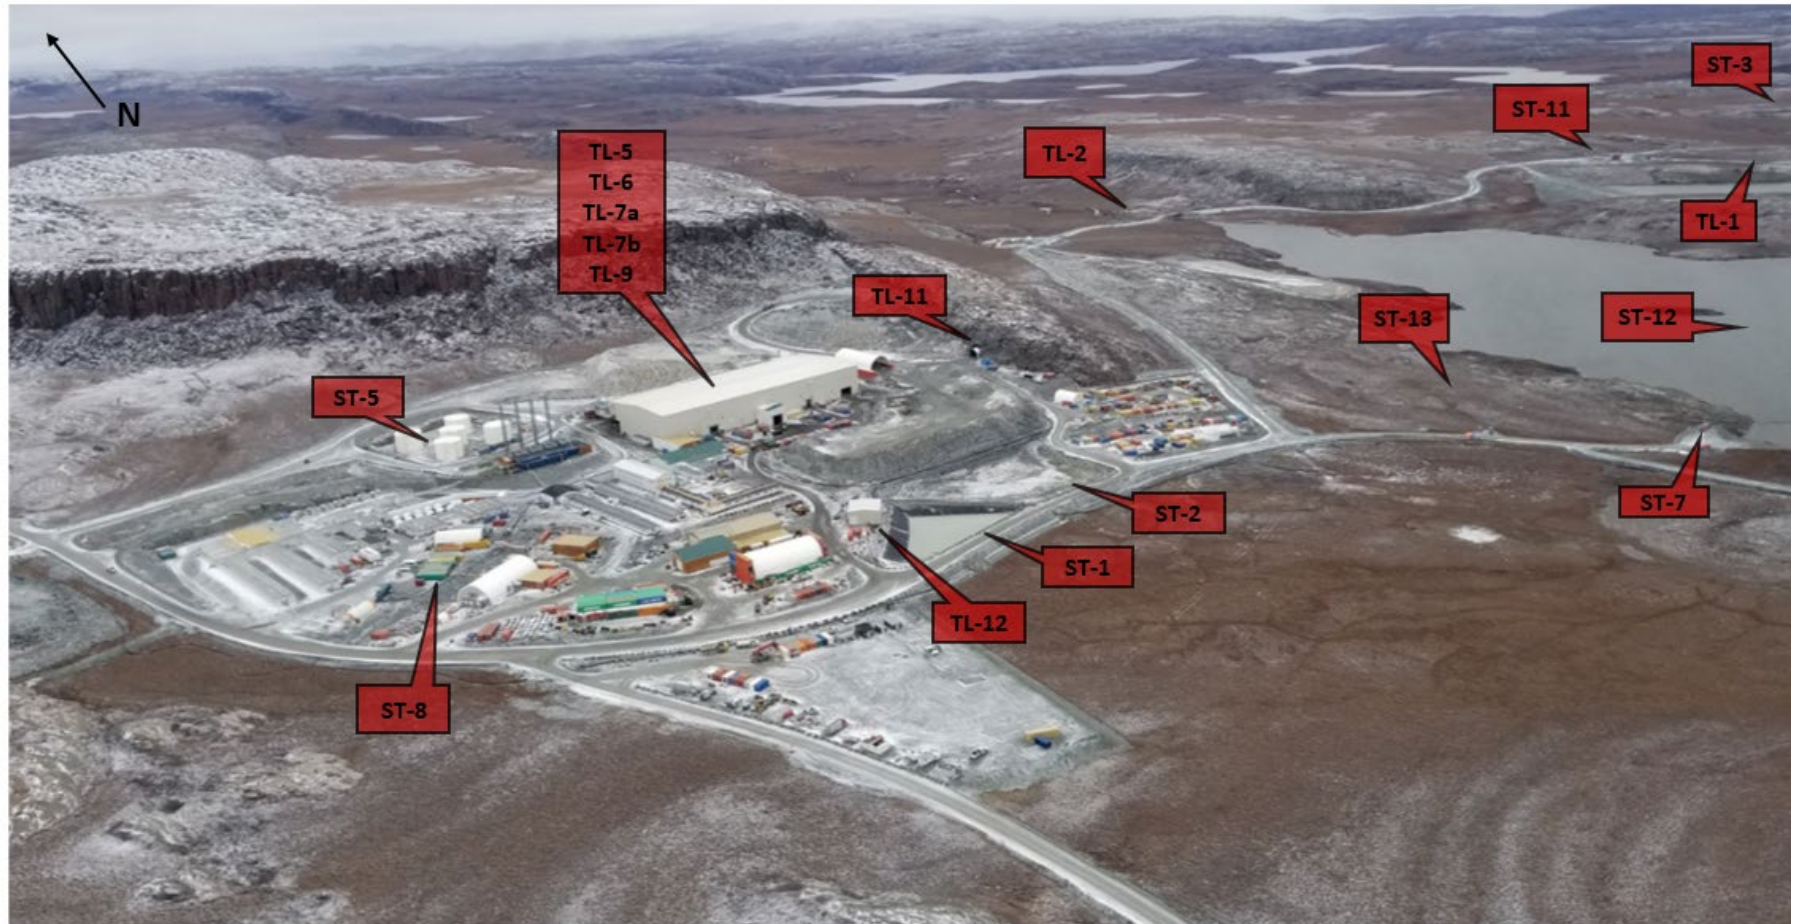

SNP Stations not shown:

- ST10 (no set location), ST13 (not yet constructed)
- TL3 (inactive), TL4 (inactive), TL10 (inactive)

Figure 3b Doris SNP Sample Stations



Figure 4 Madrid SNP Sample Stations



SNP Stations not shown:

- MMS-2, MMS-3, MMS-4a, MMS-5, MMS-6, MMS-7, MMS-8, MMS-9 and MMS-10 (not yet constructed)